


Layout drawing

Machine area make room for 1 m!

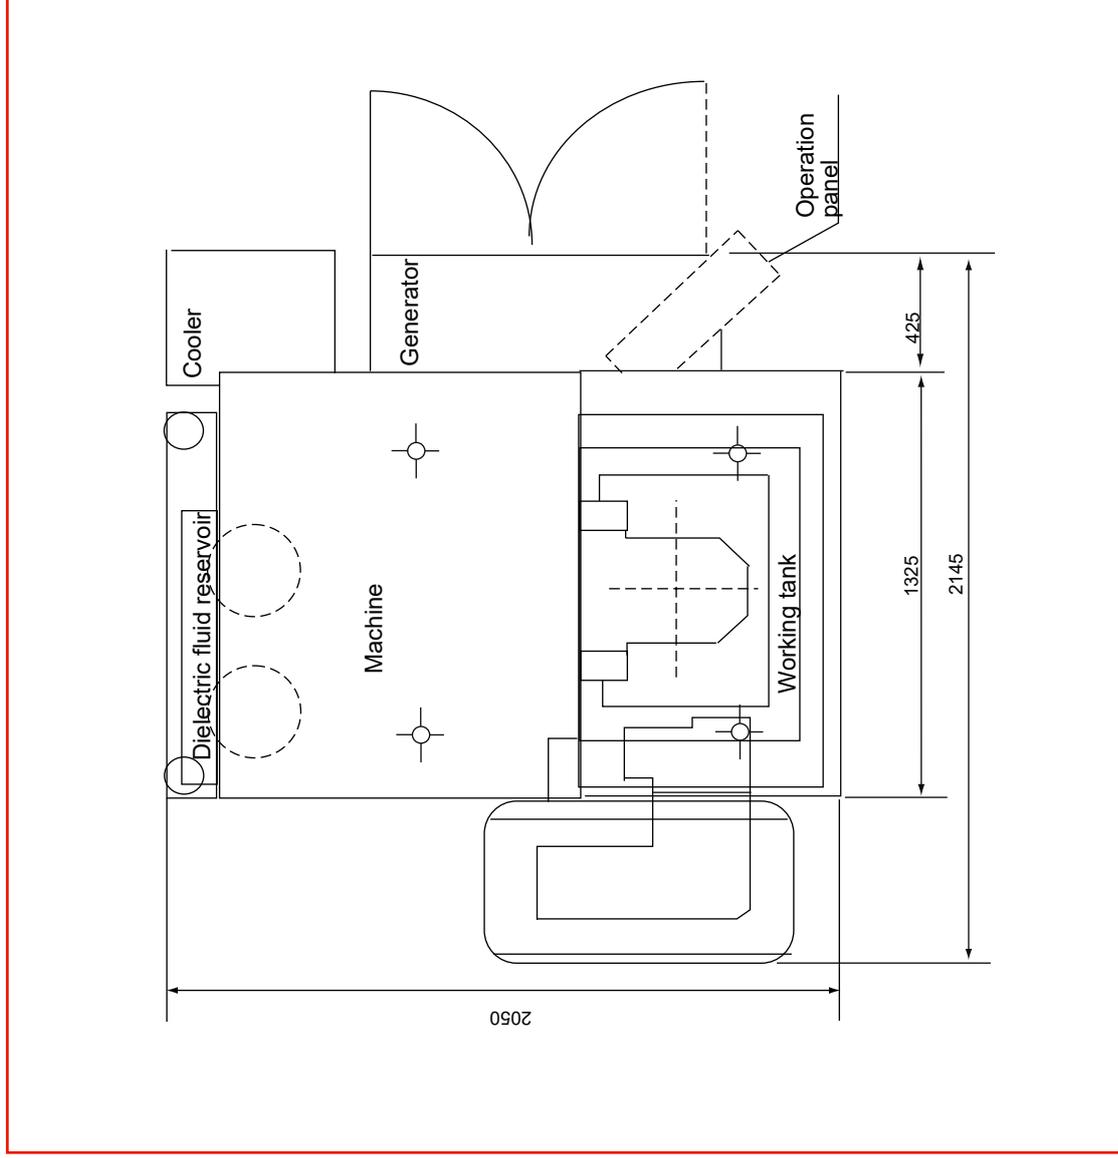

Additional information

Weight of machine body: 3725 kg
 Weight of tank without filling: 340 kg
 Weight of power supply unit: 260 kg
 Gewicht Generator 120 A: 300 kg

Hight of machine: 2335 mm

Requested minimum measurement for entrance door/gate (WXH): 2100 x 2400 mm

- 1: Power supply
 3 phases 400 V / AC, PE
 ± 10%, 50/60 Hz
 Primary fuse min. 32 A slow

Depens on the generator a transformer is necessary. A transformer with the following measures belongs to the machine:

WxDxH: (0,8 m x 0,35 m x 0,9 m)
Weight: 199 kg

The transformer is to be placed in a distance from max. 5 m to the machine. Here the max. cable length is to be considered to the cross section. The data are to be inferred from the documents of the transformer.

(Cable not included in delivery volume)

The transformer has to be connected to the electricity supply through a customer-sided provided electrician due to the different regulations for each region/country.

- 2: Pneumatic connection: 5-7 kgf/cm³ ≈ 500-700 kpa
 Air volume minimum: 27 l/min
 EROWA: 600-700 kpa
 3/8" hose connection

- 3: For a fire extinguish installation a fixed connection in the near of the controll unit is necessary. A socket is not allowed.

- 4: Network connection

- 5: The erosion system should be set up to preferably consolidated concrete floors on a suitable hard industrial ground. To the capacity of MITSUBISHI possibly necessarily becoming shielding measures do not belong in accordance with EMV guideline.

